



# 2023 Home Comfort Program

SITE PHOTOS – EXISTING & INSTALLED MEASURES  
INTEGRATED CONTROLS

June 2023


## Existing Photos: Heating System and Boilers



**Naming Convention:** Existing Photo "CUSTOMER LAST NAME"\_Heating



# Install Photos: Ductless Condenser & Condenser Tag

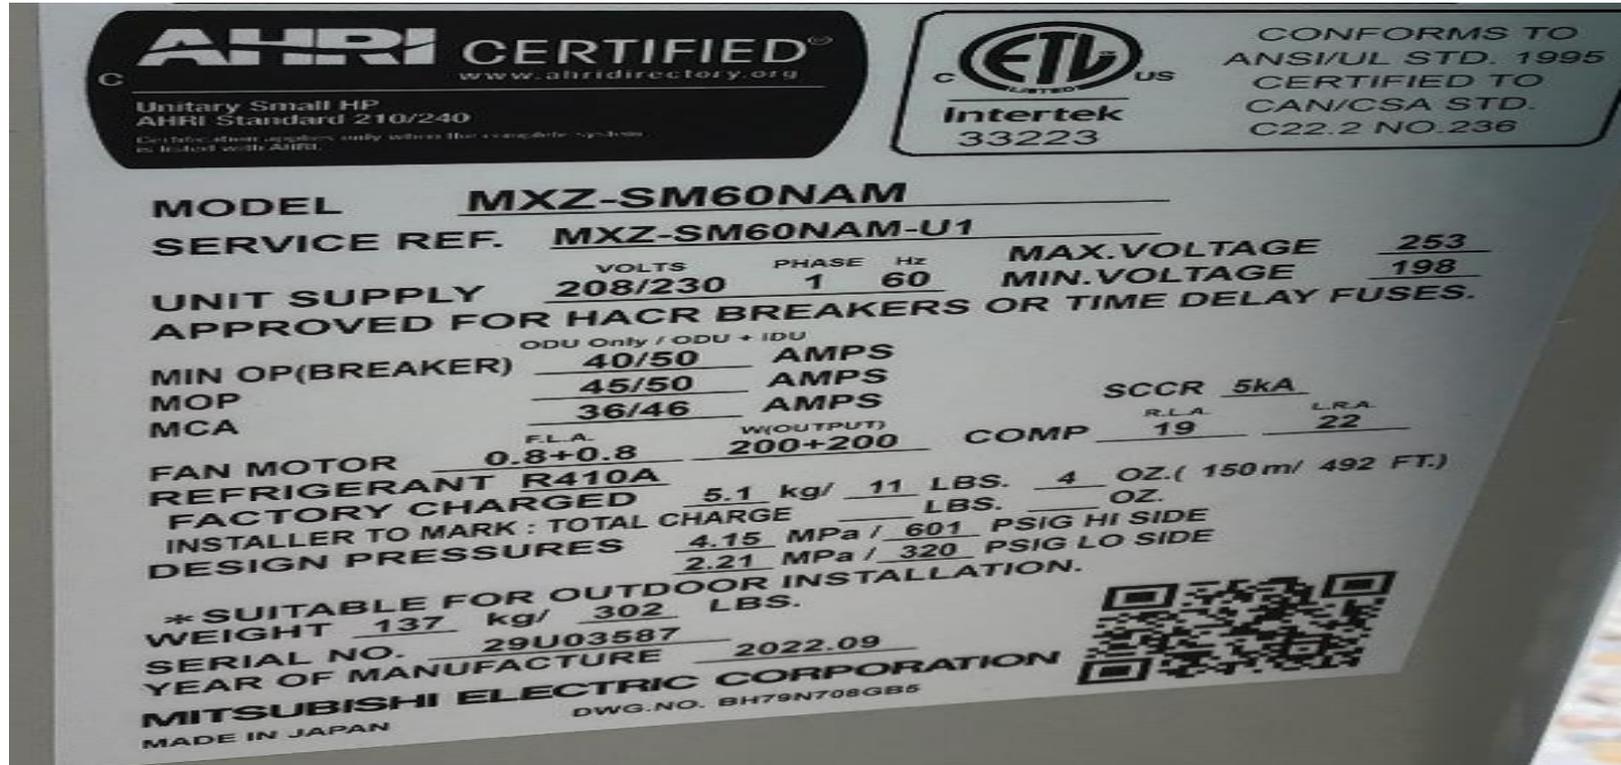


Please Process Clear Photos of the Outdoor Unit Tag, displaying the model & serial number legible

# Install Photos: Ductless Indoor Unit & Tag



**Naming Convention: Install Photo\_Customer Last name\_AH**

# Install Photos: Ductless Indoor Unit & Tag

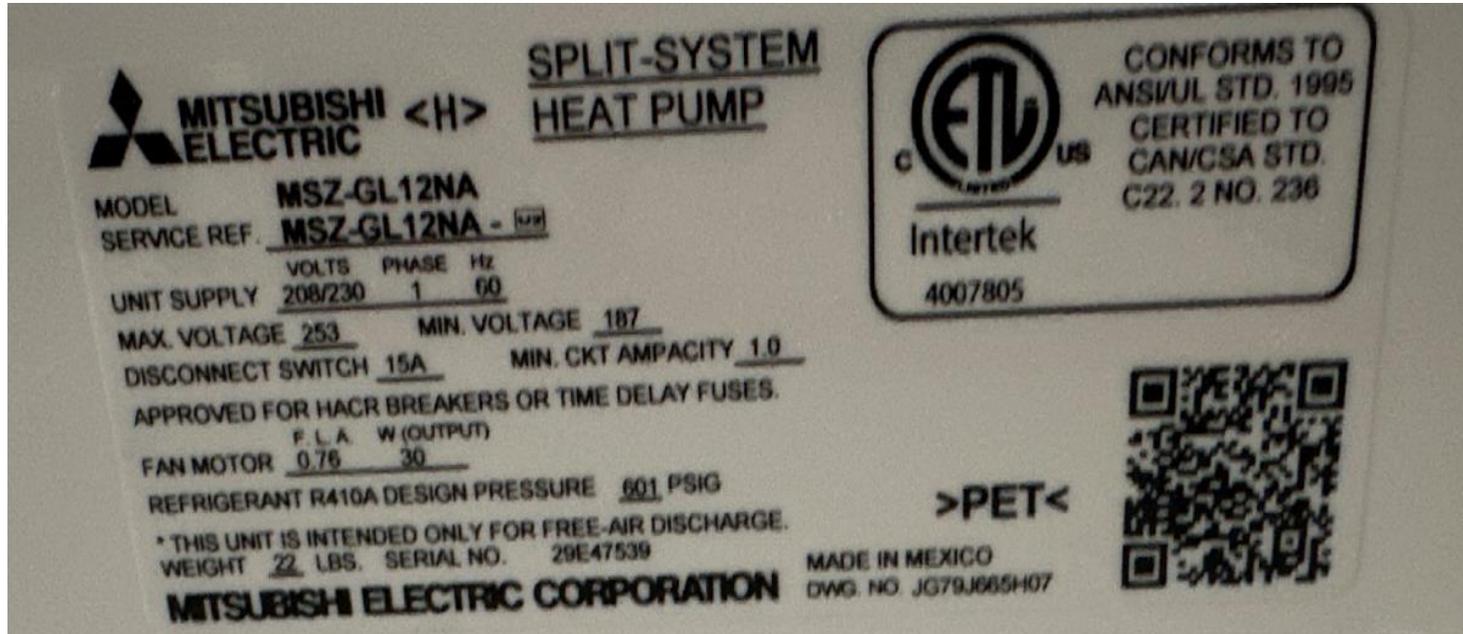

Please Process Clear Photos of the Indoor Wall Unit Tag, displaying the model & serial number legible

**Naming Convention:** Install Photo\_Customer Last name\_AH

# Install Photos: Ducted Condenser & Condenser Tag



**Naming Convention:** Install Photo\_Customer Last Name\_Condenser/CondenserTag

# Install Photos: Ducted Condenser & Condenser Tag



**Please Process Clear Photos of the** Outdoor Unit Tag, displaying the model & serial number legible


**Naming Convention:** Install Photo\_Customer Last Name\_Condenser/CondenserTag

## Install Photos: Ducted Air handler/evaporator/Fan Coil/Indoor Unit



**Naming Convention:** Install Photo\_Customer Last Name\_Ducted AH

# Install Photos: Ducted Air handler Tag

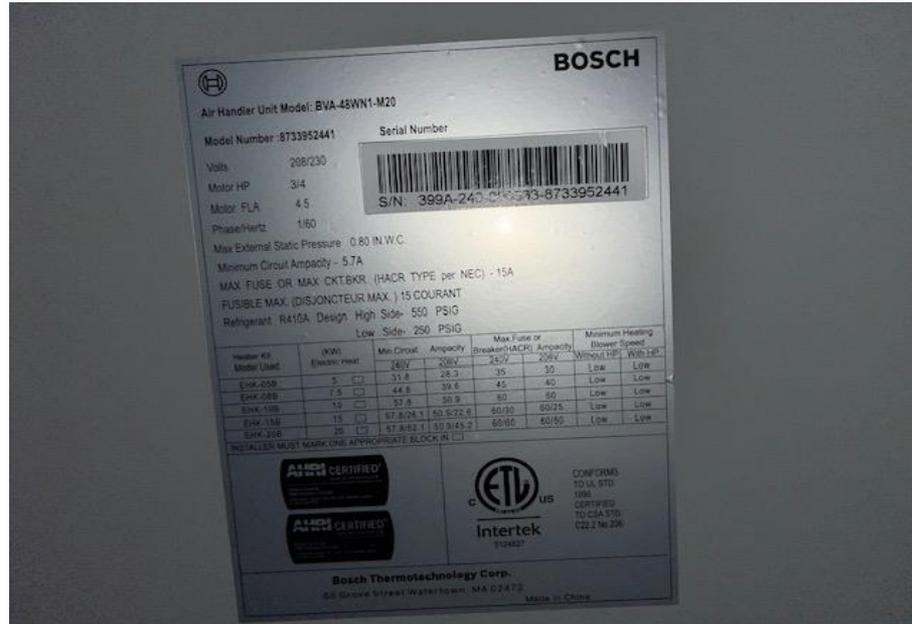

**Naming Convention: Install Photo\_Customer Last Name\_AH Tag**

# Install Photos: Water Heaters



**Naming Convention:** Install Photo\_Customer Last Name\_Water Heater


# Install Photos: Water Heaters



**Please Process Clear Photos of the Water Heater Unit Tag, displaying the model & serial number legible**


**Naming Convention: Install Photo\_Customer Last Name\_AH Tag**

# Install Photos: Thermostat, Puck & Serial number

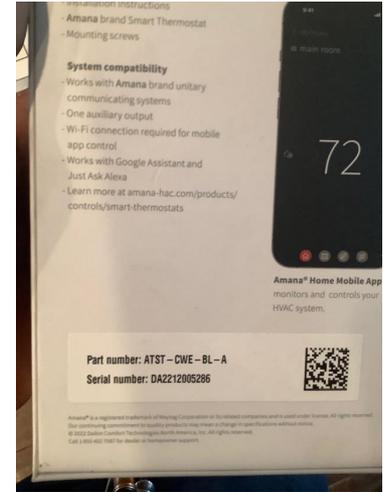

**Naming Convention:** Install Photo\_Customer Last Name\_T-Stat/Puck/T-Stat SN

# Install Photos: Thermostat, Puck & Serial number

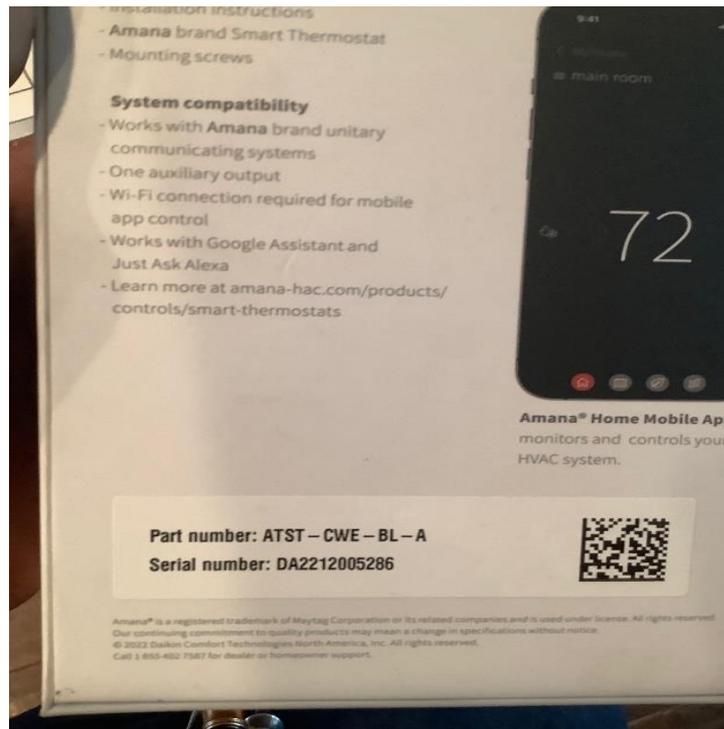

Please Process Clear Photos of the T-Stat/Puck/T-Stat; clear & legible photos of the model & serial number are required

**Naming Convention:** Install Photo\_Customer Last Name\_T-Stat/Puck/T-Stat SN

# Install Photos: Integrated Control



**Naming Convention:** Install Photo\_Customer Last name\_Integrated Control

## Additional Information

- Existing photos must clearly indicate fossil fuel by displaying the following; oil tank, oil pump on boiler or furnace, natural gas piping entering into boiler, propane tank, existing heat pump, electric resistance device, etc.
- All installed measures (eligible equipment submitted for rebate) model & serial numbers must be clearly visible
- Dual fuel thermostats/integrated controls and/or other eligible controls require photos of model & serial numbers on device or the packaging (back or side of box)
- Photo of dual fuel thermostat/integrated controls needs to be installed and powered ON.
- Each ducted or ductless cold climate heat pump system requires two photos of the indoor unit of the unit entered on the workbook. Only one indoor unit input requirement on “ASHP Equipment Information” tab on the workbook, these photos should match the input.
- **Integrated controls should include two items:**
  - The integrated control part (Flair puck; D6; etc)
  - The thermostat the integrated part talks to (wifi enabled tstat: Honeywell T5, T6, T9, T10, ecobee or Nest for the Flair puck; T6 for the D6 for example)

**NOTE: Please use Microsoft Word for projects with several photos to consolidate into one file.**

*For question or concerns please email [homecomfortli@pseg.com](mailto:homecomfortli@pseg.com)*